

Project:

Order No: Premio EPS100 Compression test

Part No: Premio EPS100/2021_05_17


Customer: Premio Hungária

Tester: Thümler GmbH-Z5

Method: MSZ EN 826

Execution date: 2021. 05. 17. 13:57:43

Chart:

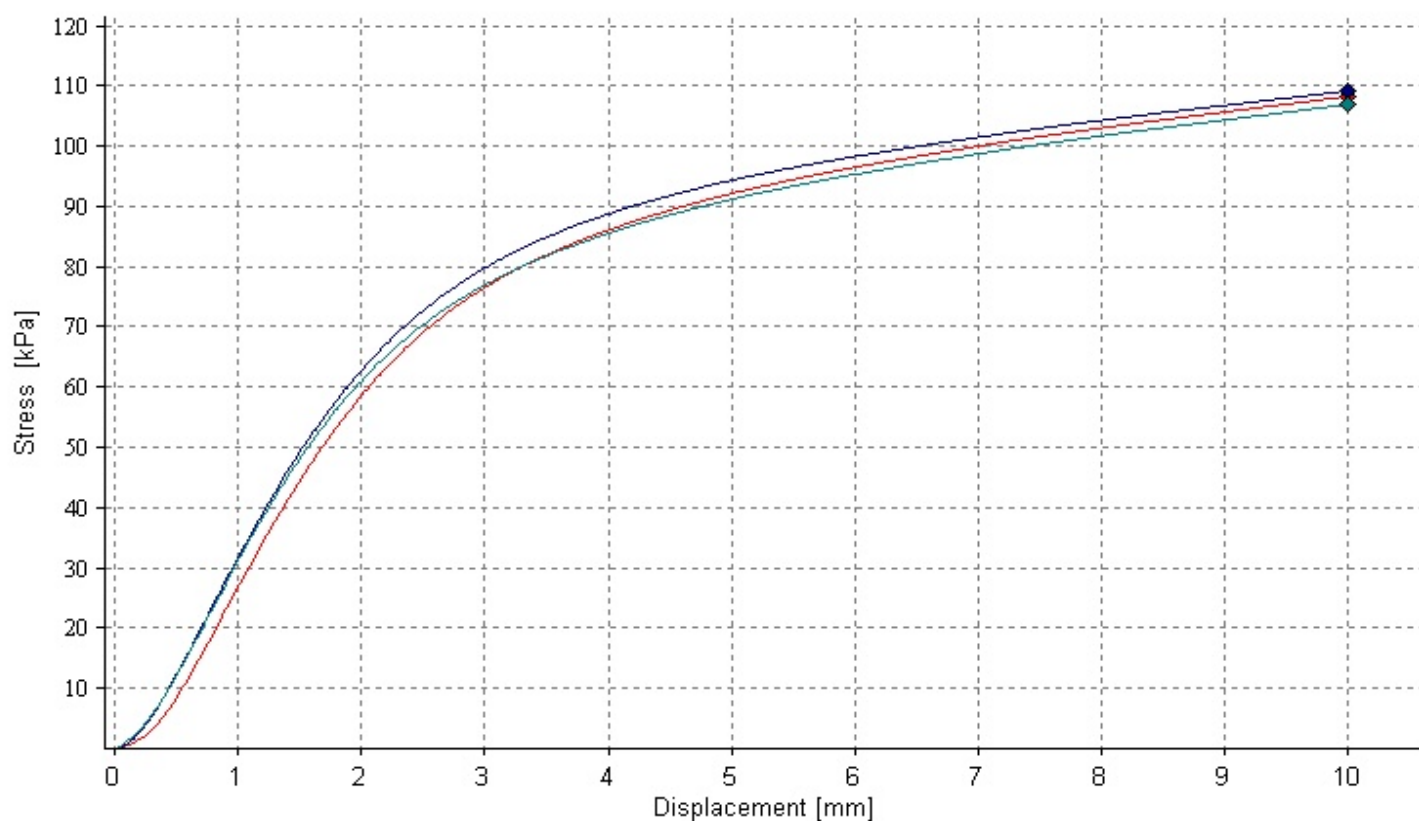

Results:

Nom	Stress [kPa] ,max.	Displacement [mm] ,max.
Premio EPS100/2021_05_17(1)	108,23	10,00
Premio EPS100/2021_05_17(2)	109,17	9,99
Premio EPS100/2021_05_17(3)	106,90	9,99
Max.	109,17	10,00
Min.	106,90	9,99
Mean	108,10	9,99